



## The Aanwizjing Result of RFQ NO: KPJB-NR-2023-0548

Day / Date: Wednesday, January 17, 2024.

Time: 09.00 WIB – Finish

Venue: Zoom

Administration:

<p>Before:</p> <p>There are additions and changes to the <b>Public Notice</b> as follows :</p> <p>5. <b>Bid Closing date and Time on 11.00 WIB, <u>January 25, 2024.</u></b></p>	<p>After:</p> <p>There are additions and changes to the <b>Public Notice</b> as follows :</p> <p>6. <b>Bid Closing date and Time on 11.00 WIB, <u>January 23, 2024.</u></b></p>
--	---

Technical:


<p>Before:</p>	<p>After:</p> <p>There are additions and changes to the <b>TOR</b> (Term of Reference) as follows :</p> <p><b>IV. SCOPE OF WORKS</b></p> <p><b>A. Minimum Clasification of Candidate Supplier</b></p> <p>8. The Supplier has his own press (splicing machine) with minimum 1 units and still functioning properly, proven by the result of equipment inspection <b>(tools must be ready at PT KPJB 24 hours)</b></p> <p><b>B. Ex Used Material</b></p> <p>Any waste material must be placed in the designated location alongside with information to warehouse KPJB properly and becomes the responsibility of the supplier for the process of cleaning or waste material mobilization <b>to laydwon</b>. All working status declared complete if the dirt/rubbish/used work waste has been cleaned with a maximum time limit of 1 week after the job is completed.</p>
----------------	---

Note:

- Closing date of bidding document submission: not later than **11.00 WIB date January 23, 2024** at 2nd gate of PT. KPJB's security.
- The others clauses, terms and conditions of this RFQ that not speicified in this MOM of aanwijzing and not against this MOM of aanwijzing still remains unchanged
- Duty stamp for quotation should follow the new Government's regulation (duty stamp 10.000).
- KPJB safety rules and GTC as attached.
- Term of Reference as attached.

Attendance List: Aanwijzing RFQ No. KPJB-NR-2023-0548

NO.	NAME	COMPANY / POSITION	Signature
1	Agung Budi R	PT. KPJB (user)	By Zoom
2	Azka	PT. KPJB	By Zoom
3	Tofan	PT. Alan Perkasa	By Zoom
4	Vikki	PT. Suprabakti Mandiri	By Zoom
5	Ana	PT. Kalinyamat Perkasa	By Zoom
6	Annisa	PT. Raja Voltama Electric	By Zoom
7	Udin	PT. Lumbang Usaha Mulia	By Zoom

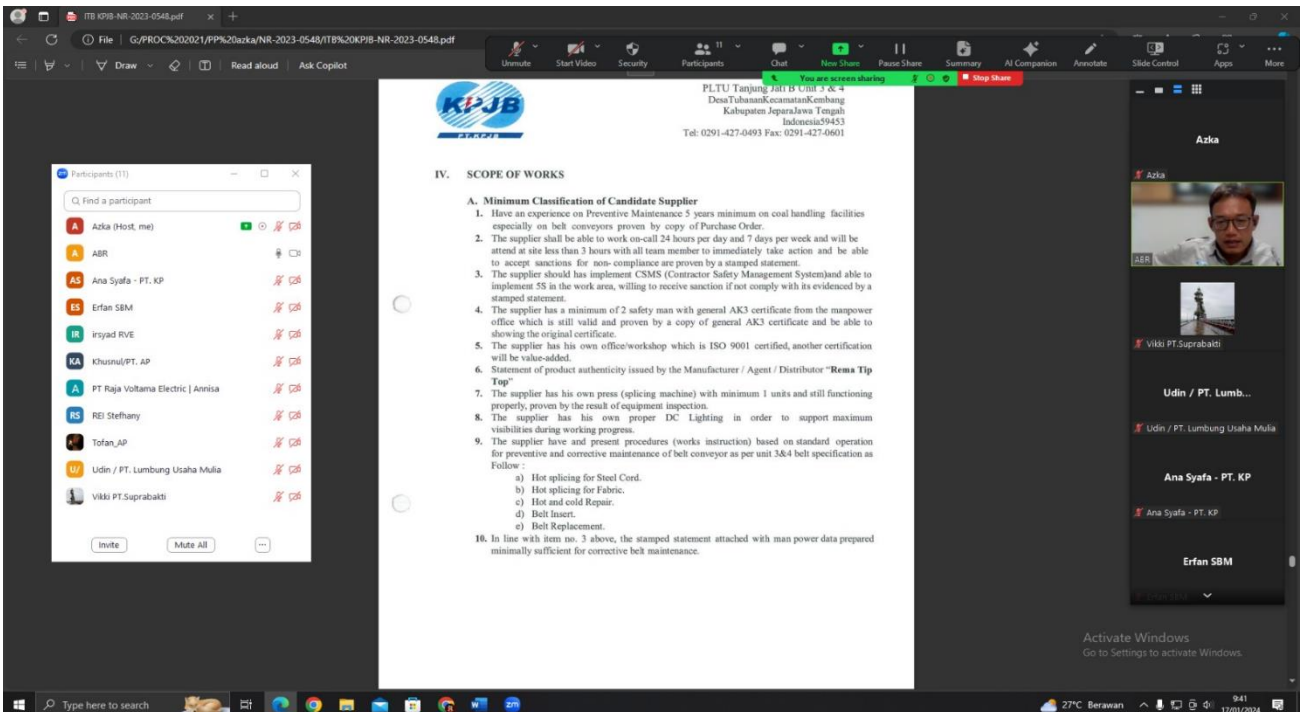

The screenshot shows a Zoom meeting interface. The main window displays a PDF document with the following content:

PLTU Tanjung Jati B Unit 3 & 4  
Desa TubanREKosmasariKembang  
Kabupaten JeparaJawa Tengah  
Indonesia59453  
Tel: 0291-427-0493 Fax: 0291-427-0601

**IV. SCOPE OF WORKS**

**A. Minimum Classification of Candidate Supplier**

1. Have an experience on Preventive Maintenance 3 years minimum on coal handling facilities especially on belt conveyors proven by copy of Purchase Order.
2. The supplier shall be able to work on-call 24 hours per day and 7 days per week and will be attend at site less than 3 hours with all team member to immediately take action and be able to accept sanctions for non-compliance are proven by a stamped statement.
3. The supplier should has implement CSMS (Contractor Safety Management System) and able to implement 5S in the work area, willing to receive sanction if not comply with its evidenced by a stamped statement.
4. The supplier has a minimum of 2 safety man with general AK3 certificate from the manpower office which is still valid and proven by a copy of general AK3 certificate and be able to showing the original certificate.
5. The supplier has his own office/workshop which is ISO 9001 certified, another certification will be value-added.
6. Statement of product authenticity issued by the Manufacturer / Agent / Distributor "Rema Tip Top"
7. The supplier has his own press (splicing machine) with minimum 1 units and still functioning properly, proven by the result of equipment inspection.
8. The supplier has his own proper DC Lighting in order to support maximum visibilities during working progress.
9. The supplier have and present procedures (works instruction) based on standard operation for preventive and corrective maintenance of belt conveyor as per unit 3&4 belt specification as Follow :
  - a) Hot splicing for Steel Cord.
  - b) Hot splicing for Fabric.
  - c) Hot and cold Repair.
  - d) Belt Insert.
  - e) Belt Replacement.
10. In line with item no. 3 above, the stamped statement attached with man power data prepared minimally sufficient for corrective belt maintenance.

The participants list on the left includes: Azka (Host, me), ABR, Ana Syafa - PT. KP, Erfan SBM, Iryad RVE, Khusnul/PT. AP, PT Raja Voltama Electric | Annisa, REI Stefhany, Tofan\_AP, Udin / PT. Lumbang Usaha Mulia, and Vikki PT.Suprabakti.