



## The Aanwizjing Result of RFQ NO: K19209

Day / Date: Monday, January 12, 2026.

Time: 09.00 WIB – Finish.

Venue: Zoom

Administration:

Before:	After:
<ul style="list-style-type: none"><li>• Delivery time: not later than <b>April 01, 2026.</b></li></ul>	<ul style="list-style-type: none"><li>• Delivery time: not later than <b>June 30, 2026.</b></li><li>• Attached the name plates from the existing</li></ul>

Technical:


Before:	After:
---------	--------

Note:

- Closing date of bidding document submission: not later than **11.00 WIB date January 20, 2026** at 2nd gate of PT. KPJB's security.
- The quotation shall be submitted in one sealed envelope containing both the priced and unpriced proposals.
- PT. KPJB will send the **LOI** to start the work, parallel processing the Appointment Letter, Performance Bond and Purchase Order approval.
- Payment will be made by Telegraphic Transfer (T/T) fortyfive (45) days after invoice received, attached with delivery or work completion report issued by PT.KPJB.
- The others clauses, terms and conditions of this RFQ that not speicified in this MOM of aanwizjing and not against this MOM of aanwizjing still remains unchanged
- Duty stamp for quotation should follow the new Government's regulation (duty stamp 10.000).
- KPJB safety rules and GTC as attached.
- Term of Refference as attached.

Attendance List: Aanwizjing RFQ K19209

NO.	NAME	COMPANY / POSITION	Signature
1	Ali M	PT KPJB (user)	By Zoom
2	Azka	PT KPJB	By Zoom
3	Dian Joko	PT Anugerah Energi Pratama	By Zoom
4	Ana	PT Kalinyamat Perkasa	By Zoom
5	Mulyati	PT Eterna Karya Sejahtera	By Zoom

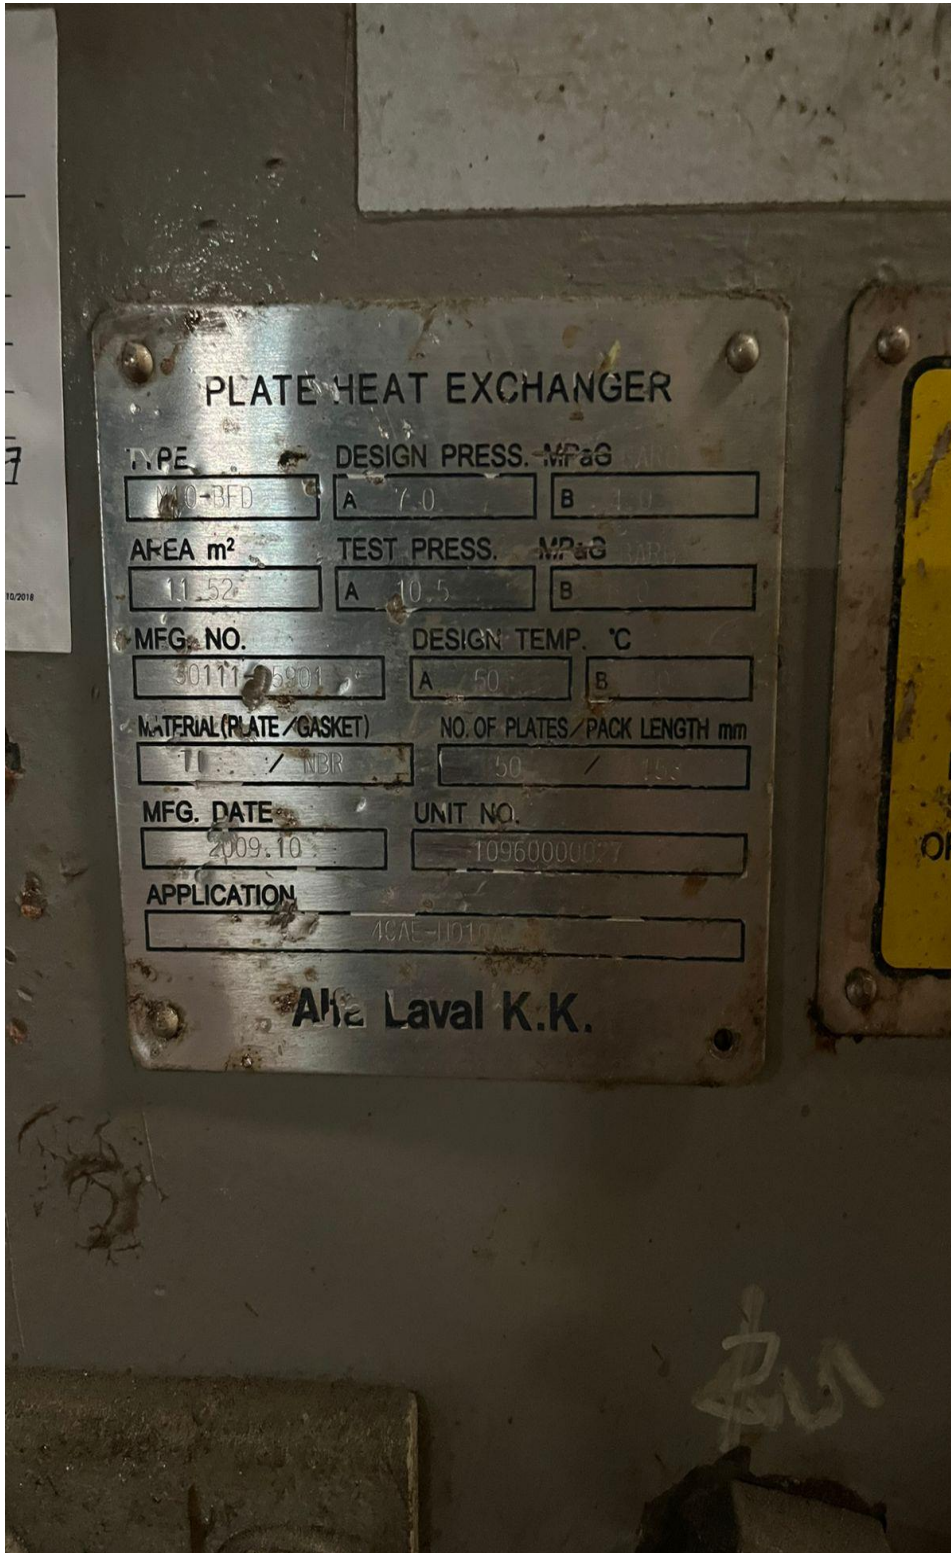

**SONDEX S**

1460-3, Songjeong-Dong, Gangseo-Gu, Busan, Korea  
 Phone : +82-51-831-7474 Fax : +82-51-831-7217 e-mail : mytec@mytec.com

Model No. **S41A-IS16**

	Hot Side	Cold Side
Design Pressure bar.g	9.8	11.0
Design Temp. °C	95	95
Test Pressure bar.g	14.7	16.5
Volume l	67.0	67.0
Heat Duty	2910	kW
Heat Transfer Area	51.47	m <sup>2</sup>
Weight (Empty/Full)	1,308 / 1,452	Kg

MAX/MIN MM  
348 / 336

**IMPORTANT**  
 The instructions in the instruction manual are to be strictly observed during installation and operation.

BUYER'S PS NO. **Z9MG12SCU-PS002**

ITEM NO. **4SCW-H023B**

ITEM NAME **STATOR COOLING WATER COOLER (B)**

PERUSAHAAN  
**PT SUPERINTEKINDIA COMP**  
 Jl. Pahlawan  
 BADA

**BUCCIFINDO**

Pemilik : **PT. PLA**  
 Owner : **WARAS**  
 Lokasi : **STATOR**  
 Nama Alat : **my Tech**  
 Merk / Pembuat : **my Tech**  
 Brand / Manufacturer : **S4-1A**  
 Model / Serial No. : **24-7-2**  
 Model / Serial No. : **24-7-2**  
 Tanggal Riiksa Uji : **24-7-2**  
 Date of Inspection :

**MEMENUHI K**

CERTIFIED BY **Mytec Co., Ltd.**

HOT SIDE	M.A.W.P.	<b>9.8 bar.g AT 95 °C</b>
	M.D.M.T.	<b>-21 °C AT 9.8 bar.g</b>
COLD SIDE	M.A.W.P.	<b>11.0 bar.g AT 95 °C</b>
	M.D.M.T.	<b>-21 °C AT 11.0 bar.g</b>
MFG. SERIAL NO.	<b>2009-0287</b>	YEAR BUILT <b>2009</b>